


Name: _____

Date: _____

Plasma Processing Day 1

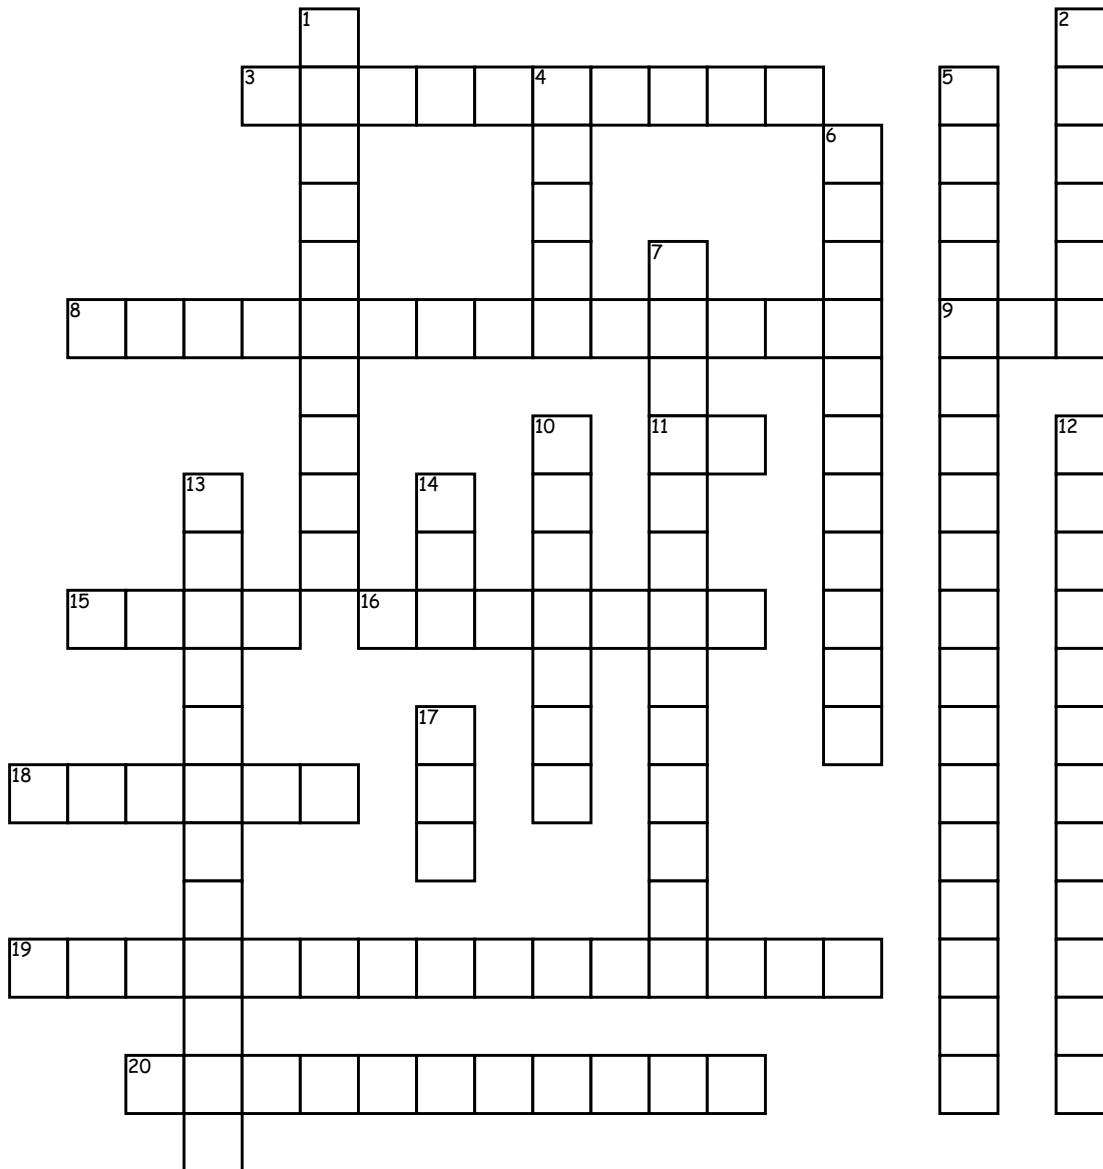

Across

- 3. Located on freezer in case it stops working
- 8. Articles or substances that can pose significant risk to health, safety, property, or environment when transported
- 9. 5mL blue snap top tube
- 11. 6mL white top tube
- 15. Dangerous Goods are divided into how many classes
- 16. Place in freezer within 1 hour

18. Handling of this requires at least two people

19. Pre-Printed Label

20. Must be at -30 C for GHA centers and -20 C for non-GHA centers

Down

- 1. Indicate Daily Production, Quarantine, Packed Products, and Samples
- 2. -20 C Degrees or Colder
- 4. Consult when using chemicals

5. Units less than 100mls

6. Place in freezer within 30 minutes

7. 99999 (WASTE)

10. Without contamination

12. Once units is rejected it must be scanned into

13. Donor Information, Collection Information (volume), testing requirements

14. -30 C Degrees or Colder

17. German FDA